



I-112



20 min. Pu to 2.5 Hours. CYCLIC TIMER

The I-112 circuit is a cyclic timer at 230 V AC with relay output. The module will maintain activated the output according to an operating time and a quiescent time, both adjustable between 20 minutes and 2.5 hours. Operating-Quiescent cycle is permanently done until you disconnect the power supply. It includes an indicator timing led, connector to place an exterior potentiometer and terminals to connect it.

Be careful. Don't forget that there is 230 VAC in several parts of the circuit.

TECHNICAL CHARACTERISTICS.

Voltage.	230 V. AC.
Medium Consumption.	1 W.
Minimum Timing.	20 minutes.
Maximum Timing.	2.5 hours.
Maximum Load at relay.	5 A.
Operating indicator Led.	Yes.


OPERATING.

MODULE'S SUPPLYING. The Circuit I-112 had to be supplied by 230 VAC. Using an adequate plug and a cable for mains connect this last one to the input terminal 230 VAC. Install a fuse and a switch as it is indicated in General Wiring Map (see hereafter). Both are necessary to protect the module and for your own security, as it is indicated in EEC regulations. Then, verify that you have correctly connected the module.

Before to connect the module to the mains inserting voltage, please do the rest of connections specified hereafter.

Do not forget that in several part of the module there is voltage (230 VAC), for this reason we suggest you to be careful.

OPERATING-QUIESCENT CYCLE. The I-112 circuit has two times. Operating time (when the relay will be connected) and quiescent time (when the relay will not be connected between two operating time). To select operating and quiescent times you have to adjust potentiometers inserted in the P.C.B. When the time is selected, press the push button to supply the module. The circuit I-112 will automatically connect the output during the previously indicated operating time and the led will light. When the operating time will be finished, led and output will be disconnected during the selected quiescent time. At the end of this quiescent time, the module I-112 will be activated once again.

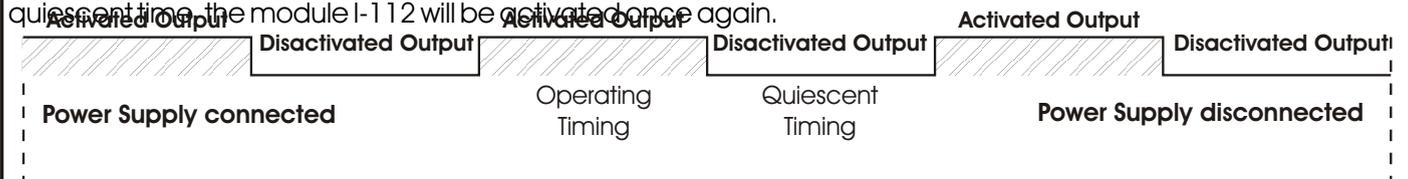

OUTPUT. CONNECTION OF THE LOAD. The output Module (I-112) is controlled by a relay, allowing any load until 5 A. as maximum consumption. The relay has 3 output terminals the normally open at quiescent (NO), the normally closed at quiescent (NC) and the common. The operating of this mechanism is the same as a switch with two (2) terminals NO and common, if you wish that the output will be activated during the timer, or between the NC and the common, to obtain the reverse operating. In the Output connection paragraph, you could appreciate the typical connection for a devices operating at 12 VDC and to operate at 230 VAC. The installation is between the Common and NO, where the device or load that you wish to control will be activated during the operating time. To obtain the inverse operating, substitute in the connection the NO by the NC.



TIMERS


Ref. Full2596112

I-112

OPERATING.


EXTERIOR INSTALLATION OF THE POTENTIOMETER : If you wish to substitute the potentiometer inserted in the P.C.B, you had to withdraw the soldering. Then, connect cables between jumpers indicated as "J1" and "J2" and new potentiometers. These last potentiometers have to be lined and offering 4M7. The cable has to

GENERAL WIRING MAP.

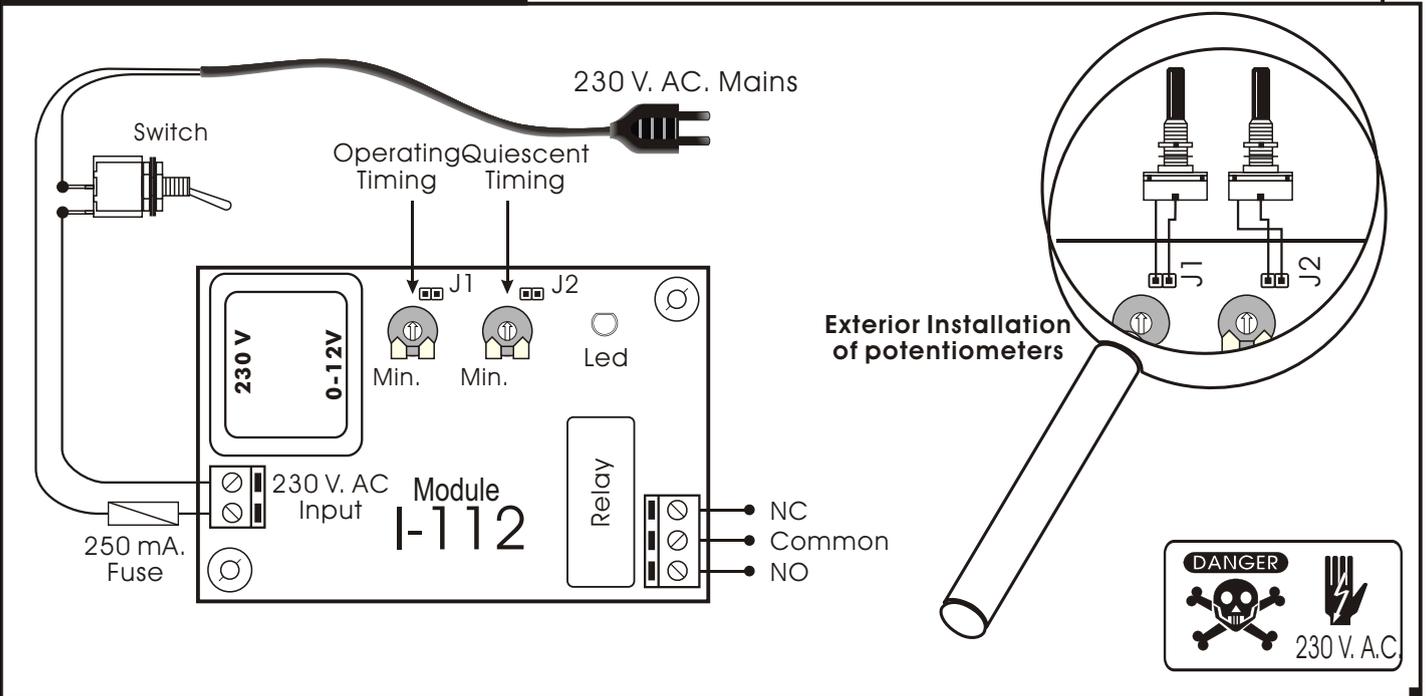


OUTPUT CONNECTION. LOAD.

12 V. DC. CONNECTION

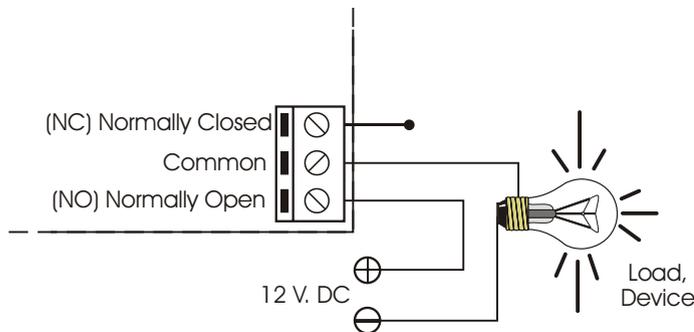

230 V. AC. CONNECTION

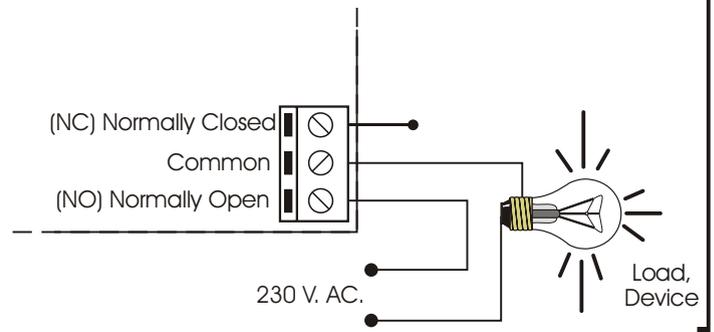

TECHNICAL CONSULTATIONS.

If you have any doubt, you could contact your wholesaler or our Technical Department.
 - Via E-Mail, sat@cebek.com | by mail P.O Box 23455 - 08080 BARCELONA - SPAIN.
 - **Keep the invoice of this module.** For any repair, the corresponding invoice had to be added. If the invoice is not presented together with this module, the module's warranty will be automatically cancelled.

All the module's CEBEK have **3 years of total warranty** in the technical

WARRANTY

**3
YEARS**

**MORE 300
MODULES.**

CEBEK is trade make of FADISEL S.L. more than 300 module's are available in stock for any purpose **request our CATALOGUE**, or visit our Web. [Http://www.cebek.com](http://www.cebek.com)